

Electrical Drawings
1 x 230VAC

+A(x)	Location :		Function :		ELECTRICAL DEPARTMENT								
	Control for Smartwall				Rev. date		28-07-2022						
CONTROL PANEL					REV		1						
Document :		HBC-FILTERBANK-UK-230V-Rev1.vsd		Order no:		Reference :		Date :	19-08-2022	Page :	1	Of :	11


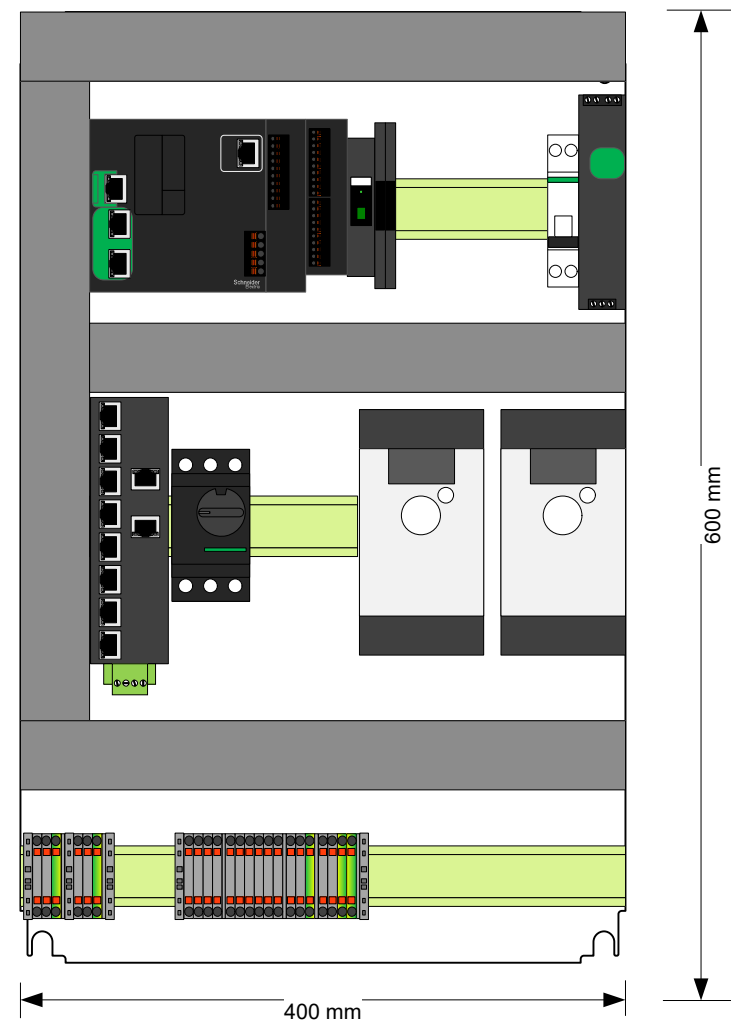



PLATE LAYOUT

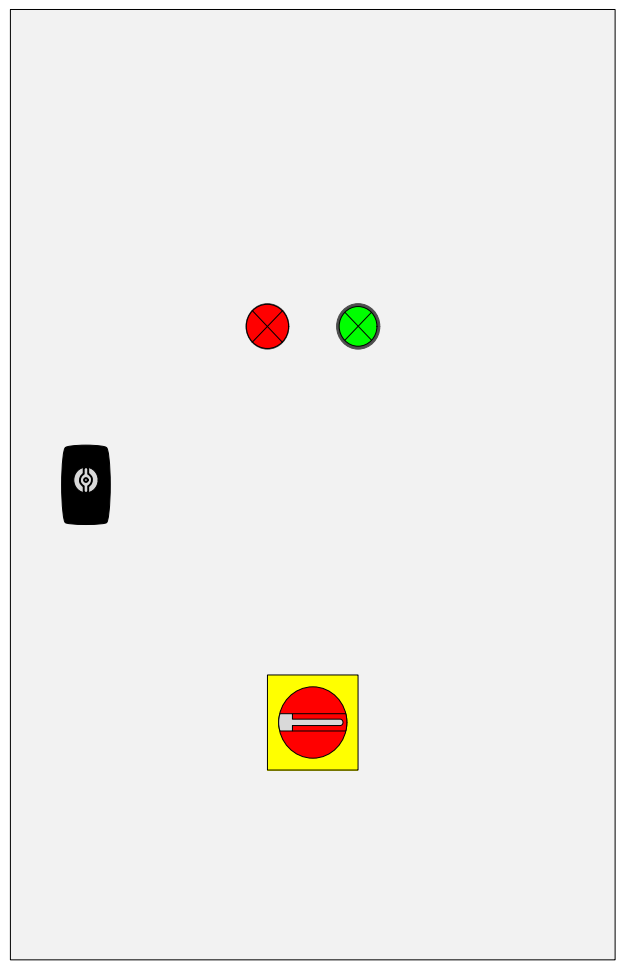

FRONT LAYOUT

+A(x) CONTROL PANEL	Location : Control SMARTWALL	Function : PANEL LAYOUT	ELECTRICAL DEPARTMENT		
	Document : HBC-FILTERBANK-UK-230V-Rev1.vsd	Order no:	Date : 19-08-2022	Rev. date 28-07-2022 REV 1	Page : 3 Of : 11


SMARTWALL

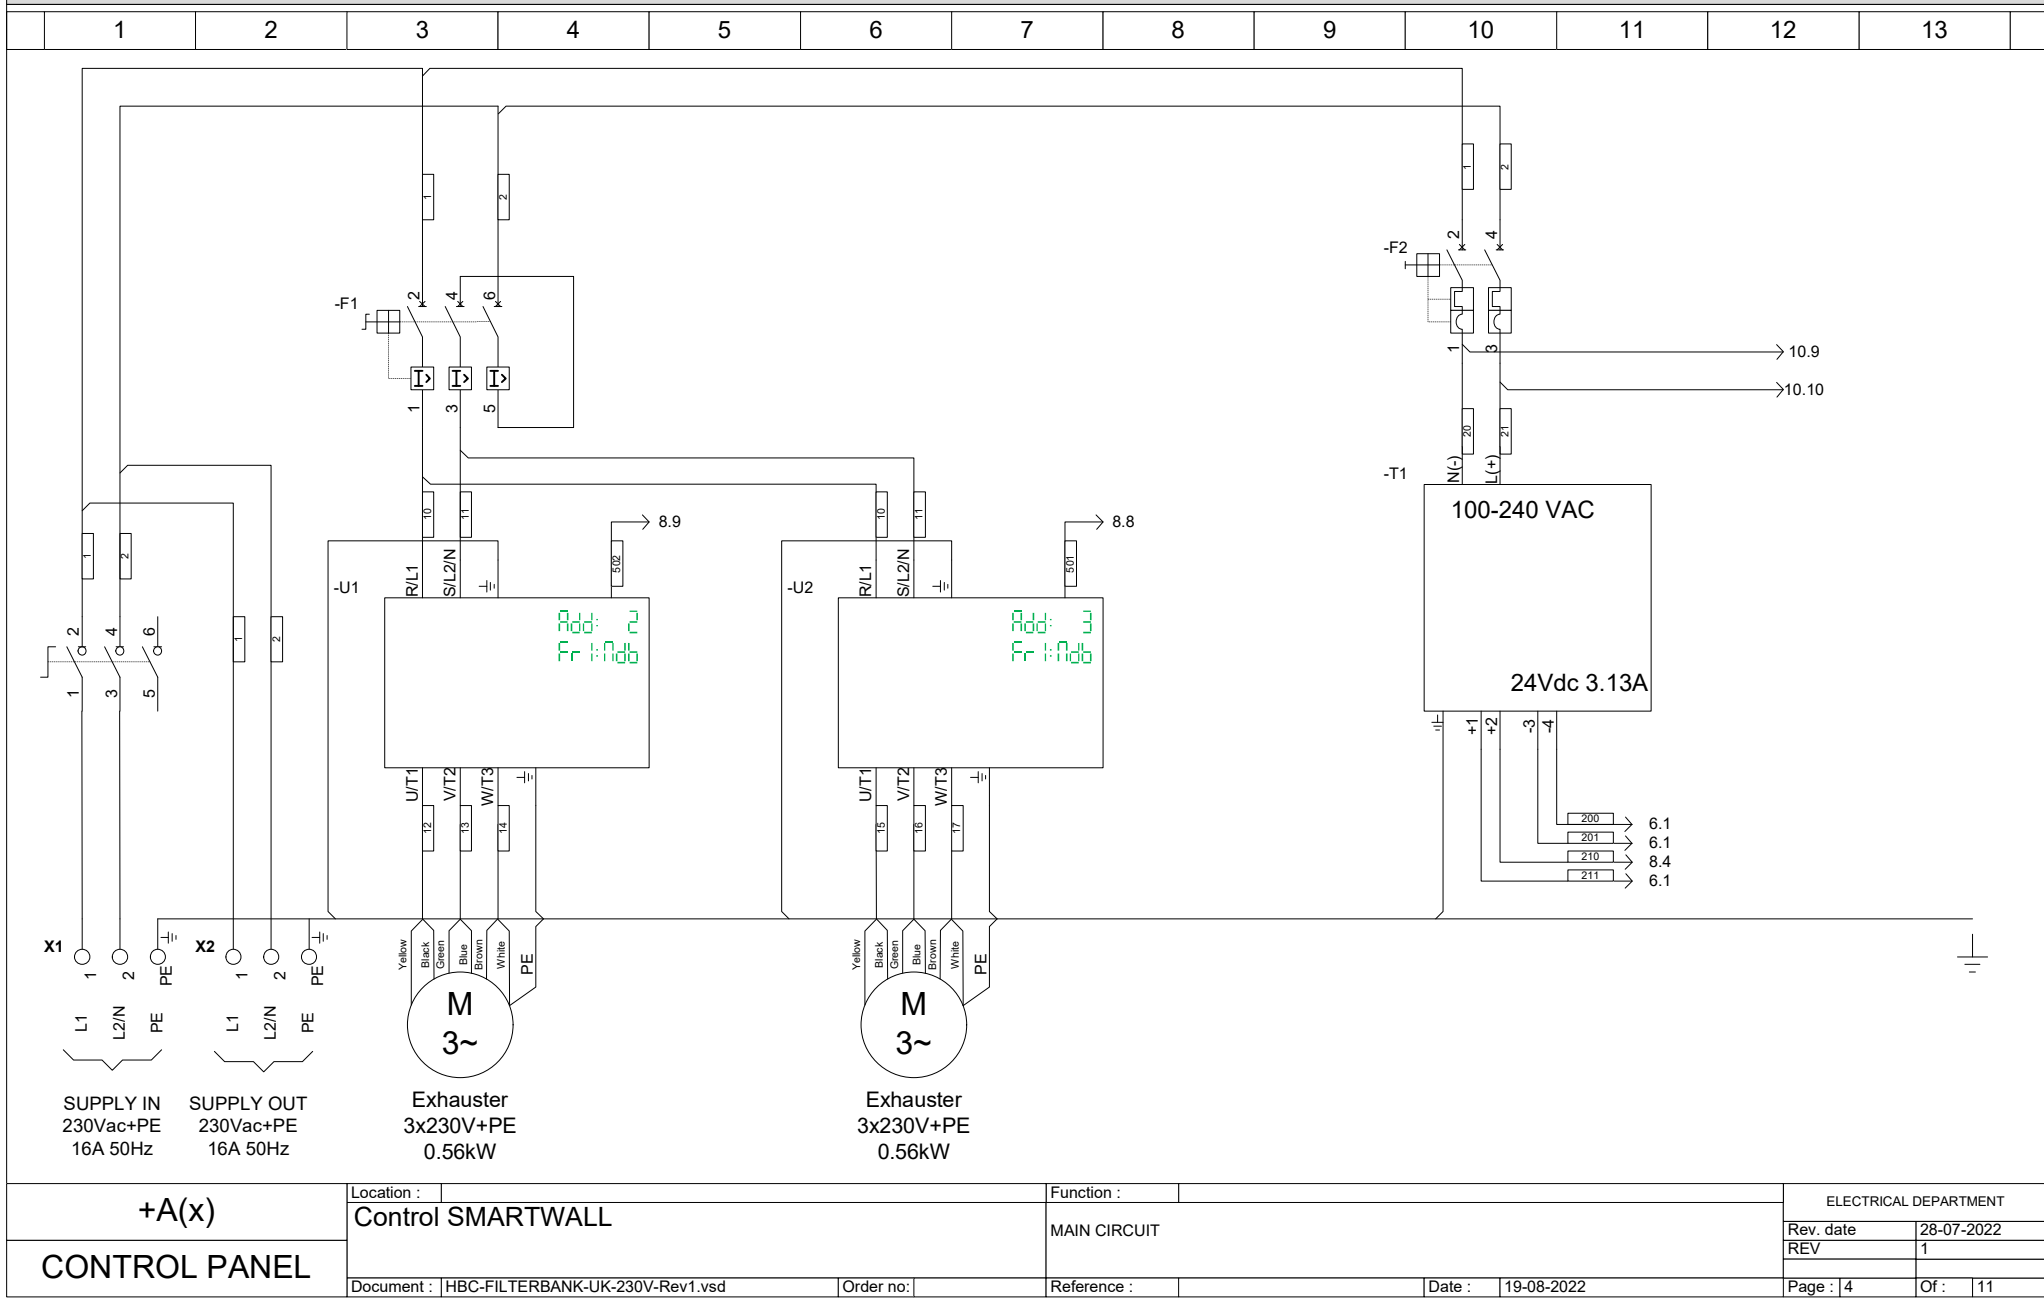


SMARTWALL



1	2	3	4	5	6	7	8	9	10	11	12	13	
---	---	---	---	---	---	---	---	---	----	----	----	----	--

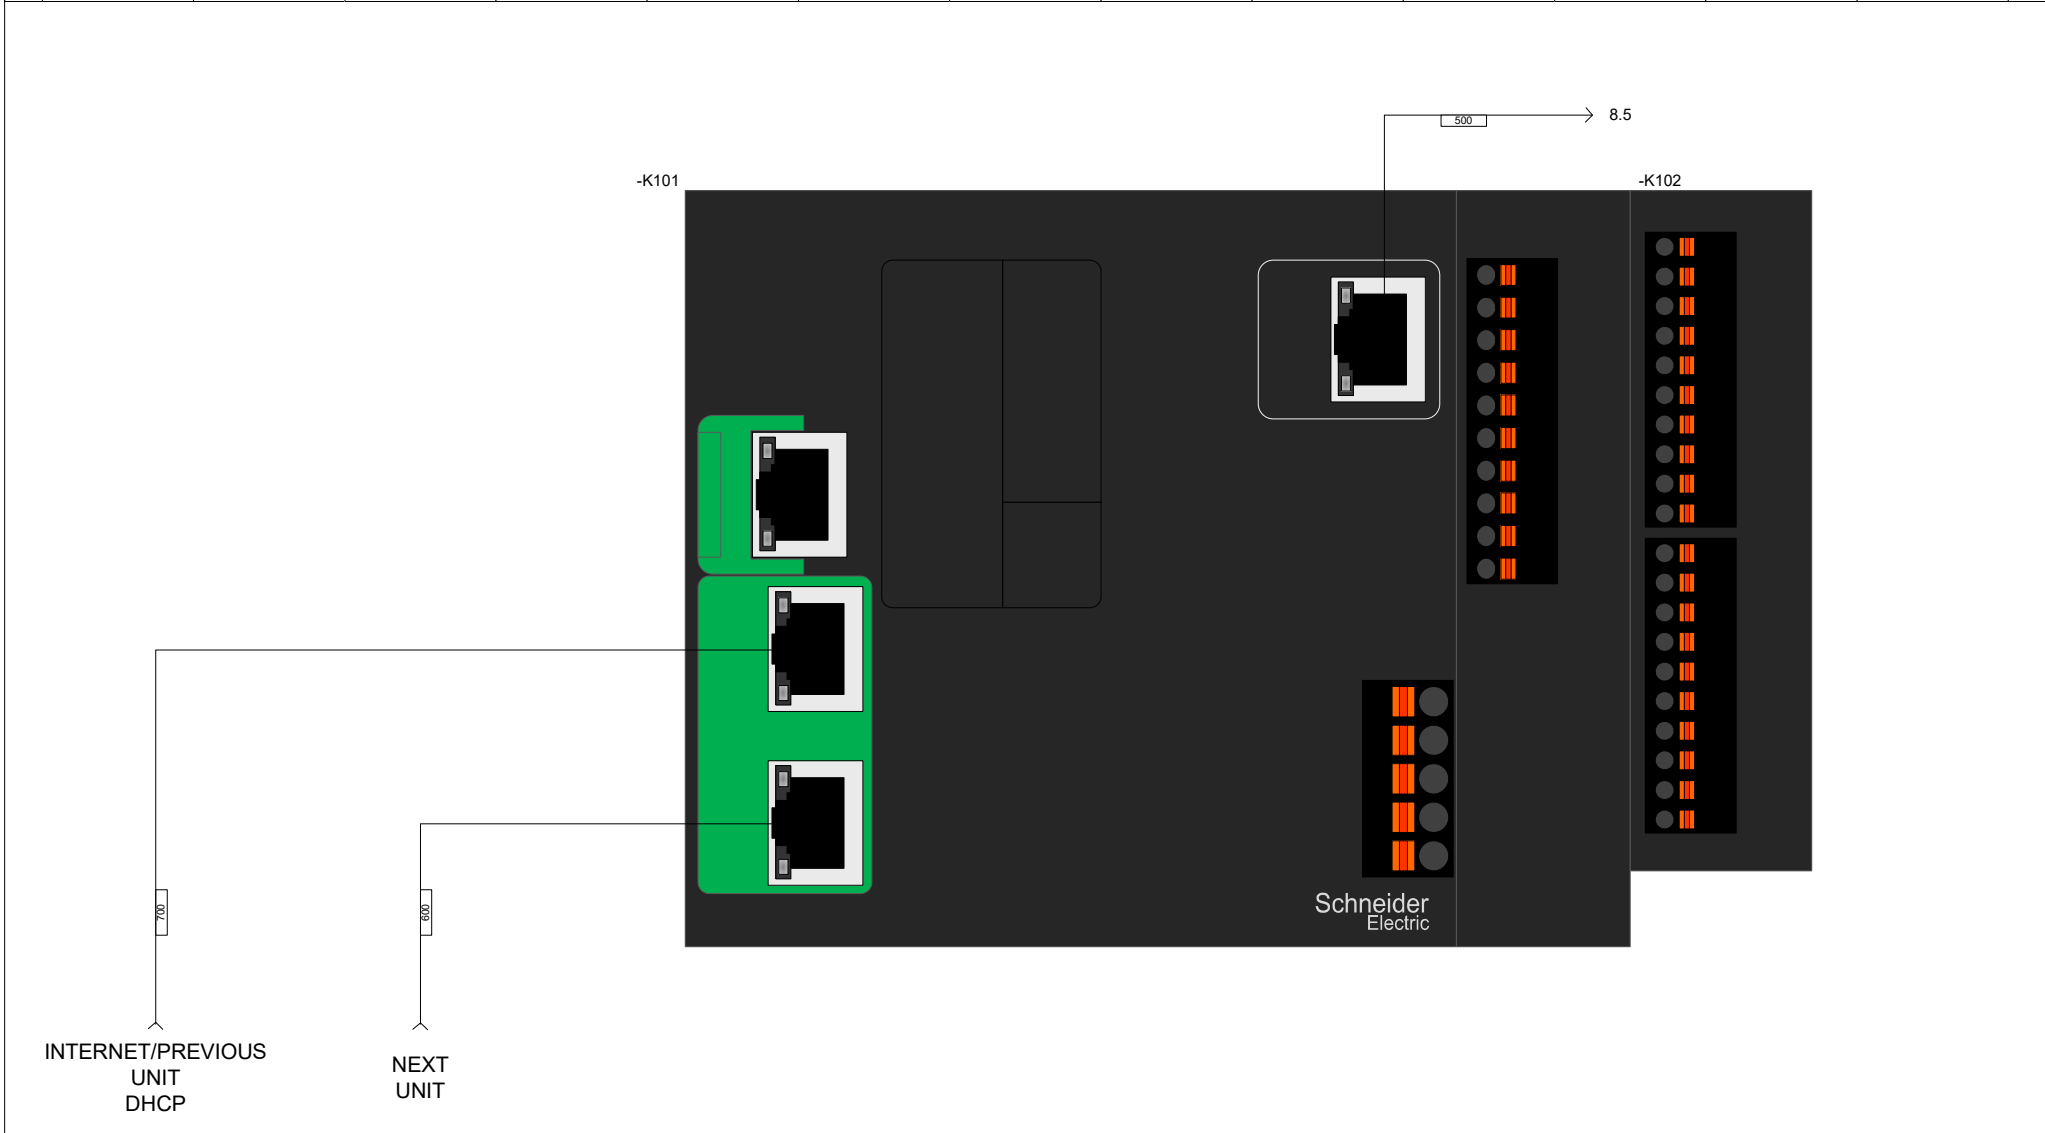

+A(x) CONTROL PANEL	Location :	Control SMARTWALL			Function :	CONTROLLER			ELECTRICAL DEPARTMENT		
	Document :	HBC-FILTERBANK-UK-230V-Rev1.vsd	Order no:		Reference :		Date :	19-08-2022	Rev. date	28-07-2022	
									REV	1	
									Page :	5	Of : 11




+A(x) CONTROL PANEL	Location : Control SMARTWALL		Function : I/O TERMINALS		ELECTRICAL DEPARTMENT							
					Rev. date	28-07-2022						
					REV	1						
	Document :	HBC-FILTERBANK-UK-230V-Rev1.vsd	Order no:		Reference :		Date :	19-08-2022	Page :	6	Of :	11

SMARTWALL



	1	2	3	4	5	6	7	8	9	10	11	12	13	
--	---	---	---	---	---	---	---	---	---	----	----	----	----	--

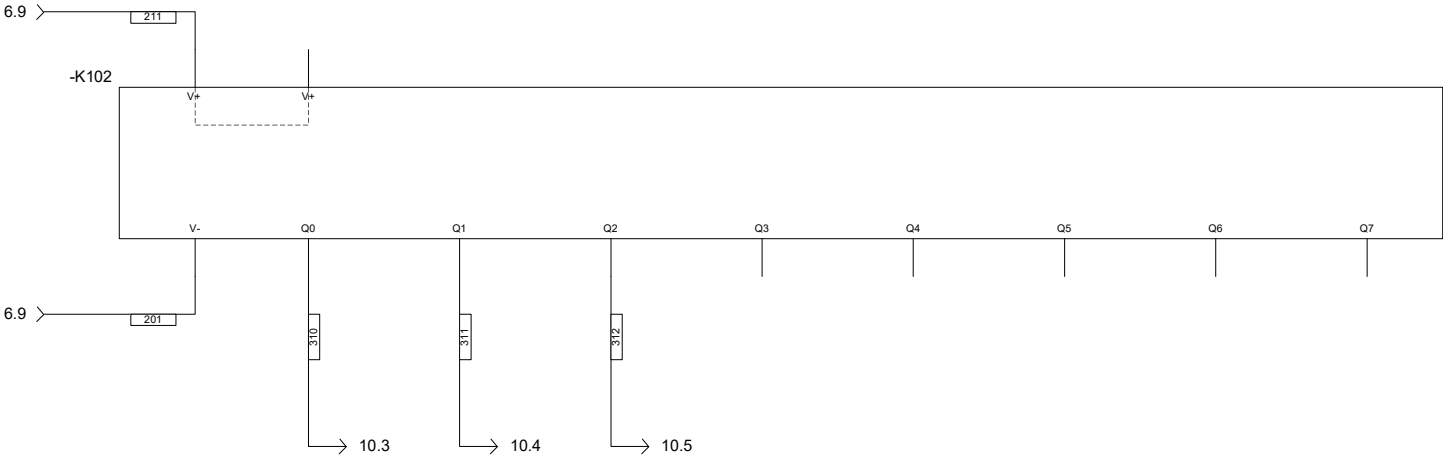

+A(x)


CONTROL PANEL

Location :	Control SMARTWALL			Function :	I/O TERMINALS			ELECTRICAL DEPARTMENT		
Document :	HBC-FILTERBANK-UK-230V-Rev1.vsd			Order no:				Rev. date	28-07-2022	
								REV	1	
								Page :	7	Of : 11

SMARTWALL




1	2	3	4	5	6	7	8	9	10	11	12	13	
---	---	---	---	---	---	---	---	---	----	----	----	----	--

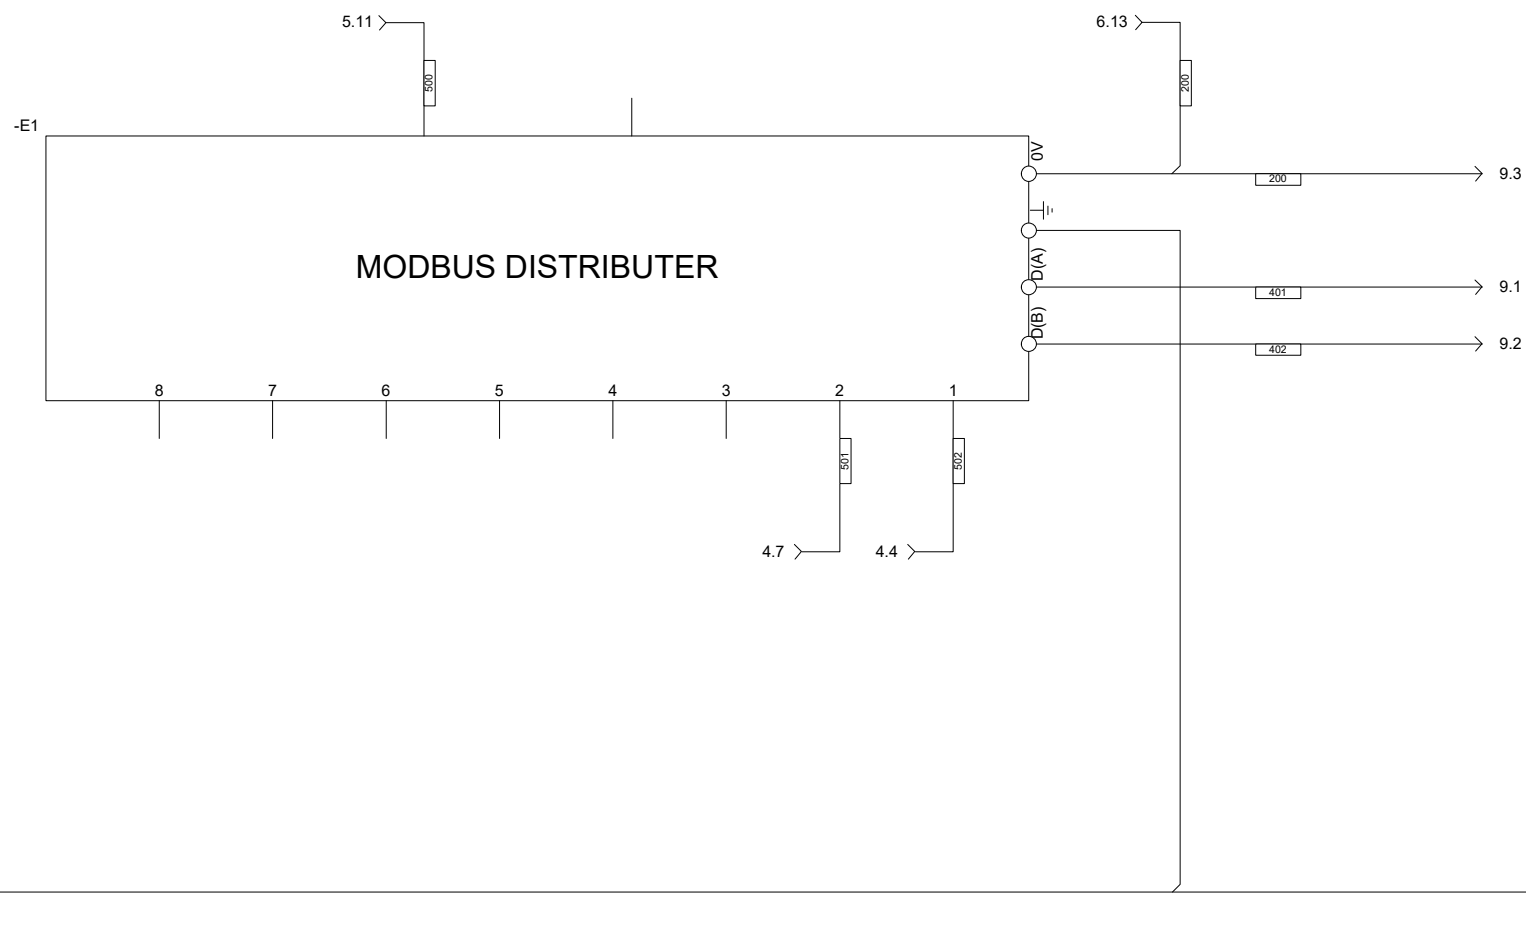


+A(x)	Location :		Function :		ELECTRICAL DEPARTMENT		
	Control SMARTWALL		MODBUS DISTRIBUTION		Rev. date	28-07-2022	
CONTROL PANEL					REV	1	
	Document : HBC-FILTERBANK-UK-230V-Rev1.vsd		Order no:	Reference :	Date :	19-08-2022	Page : 8 Of : 11

SMARTWALL

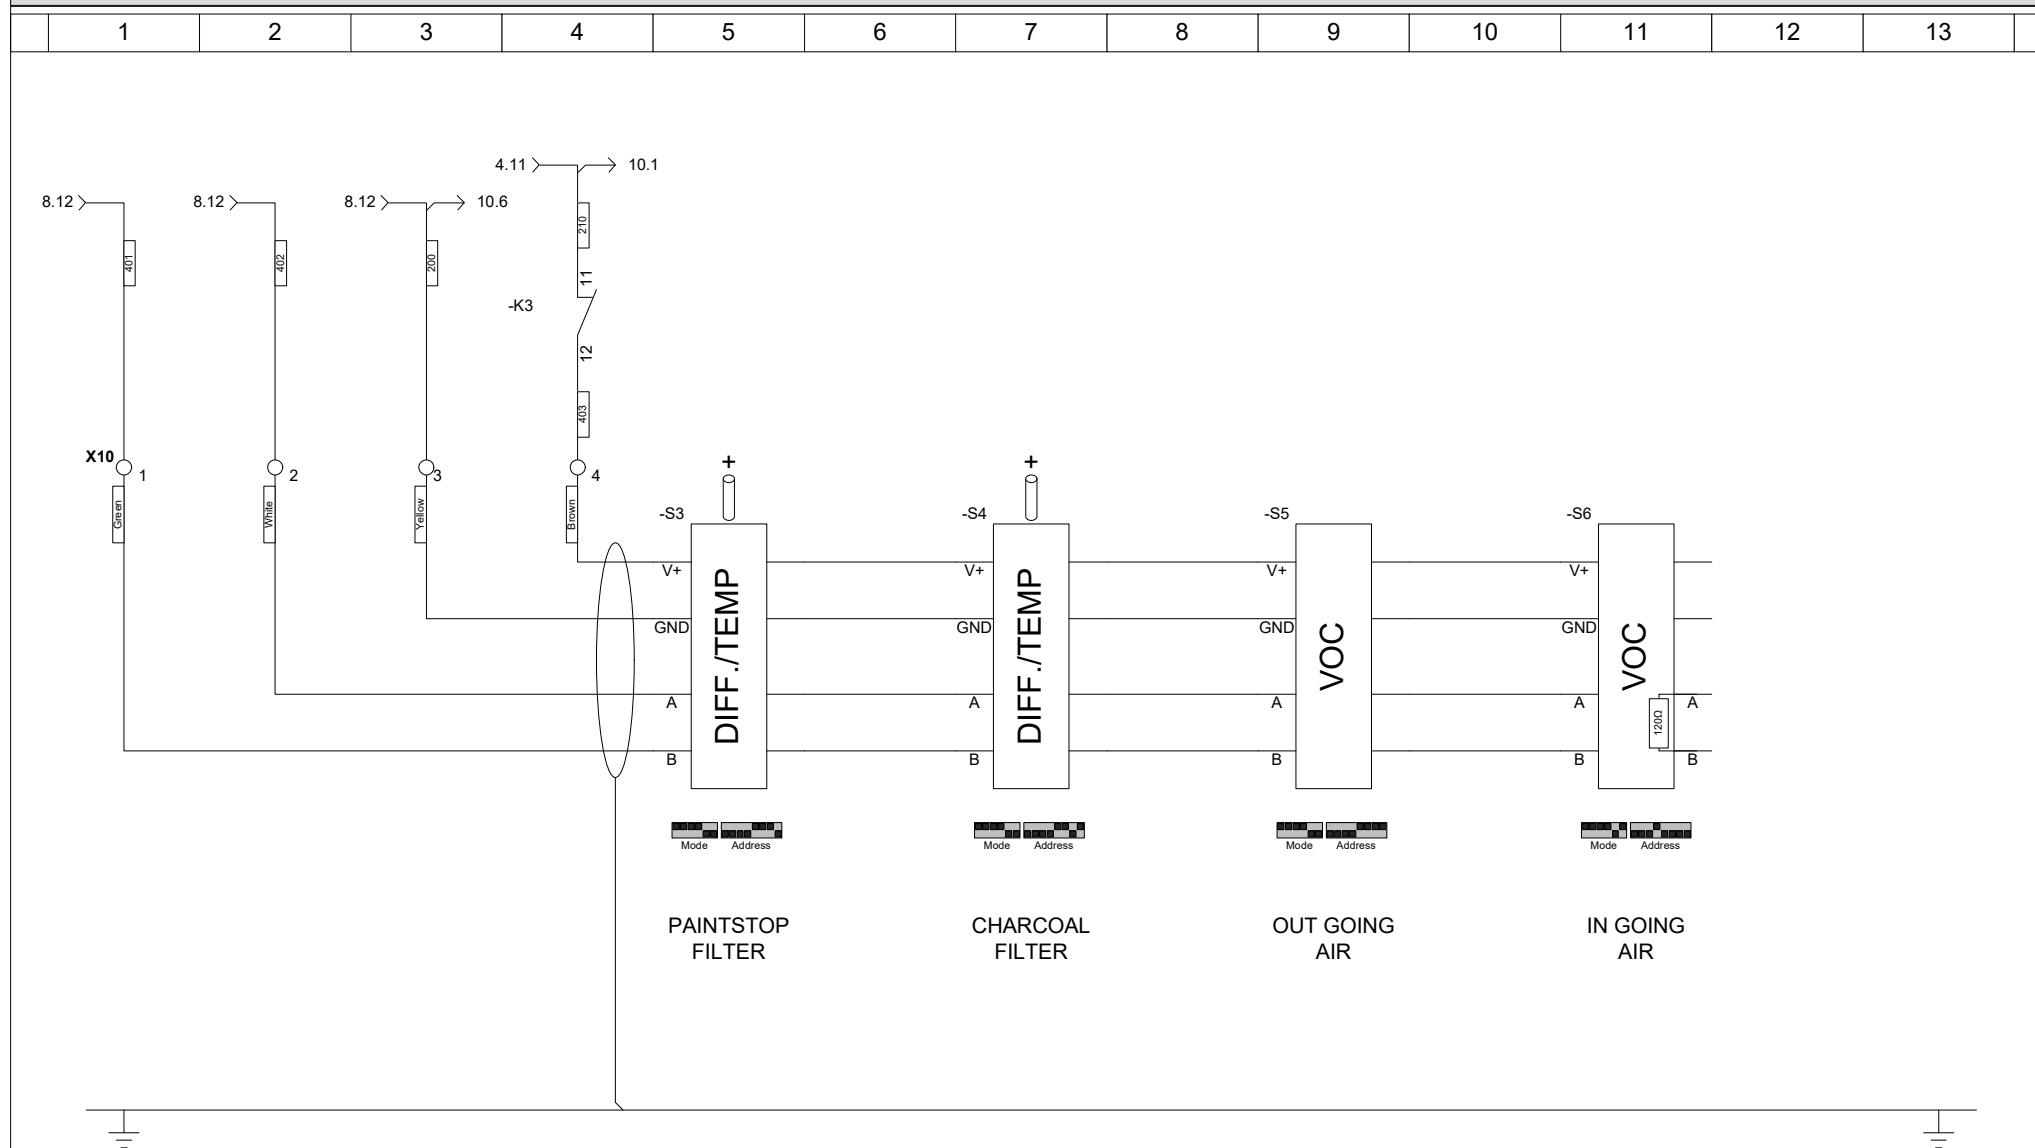


+A(x)	Location : Control SMARTWALL		Function : MODBUS SENSORS		ELECTRICAL DEPARTMENT		
	Document : HBC-FILTERBANK-UK-230V-Rev1.vsd		Order no :		Rev. date 28-07-2022		
CONTROL PANEL	Reference :		Date : 19-08-2022		REV 1		
	Page : 9		Of : 11				

SMARTWALL

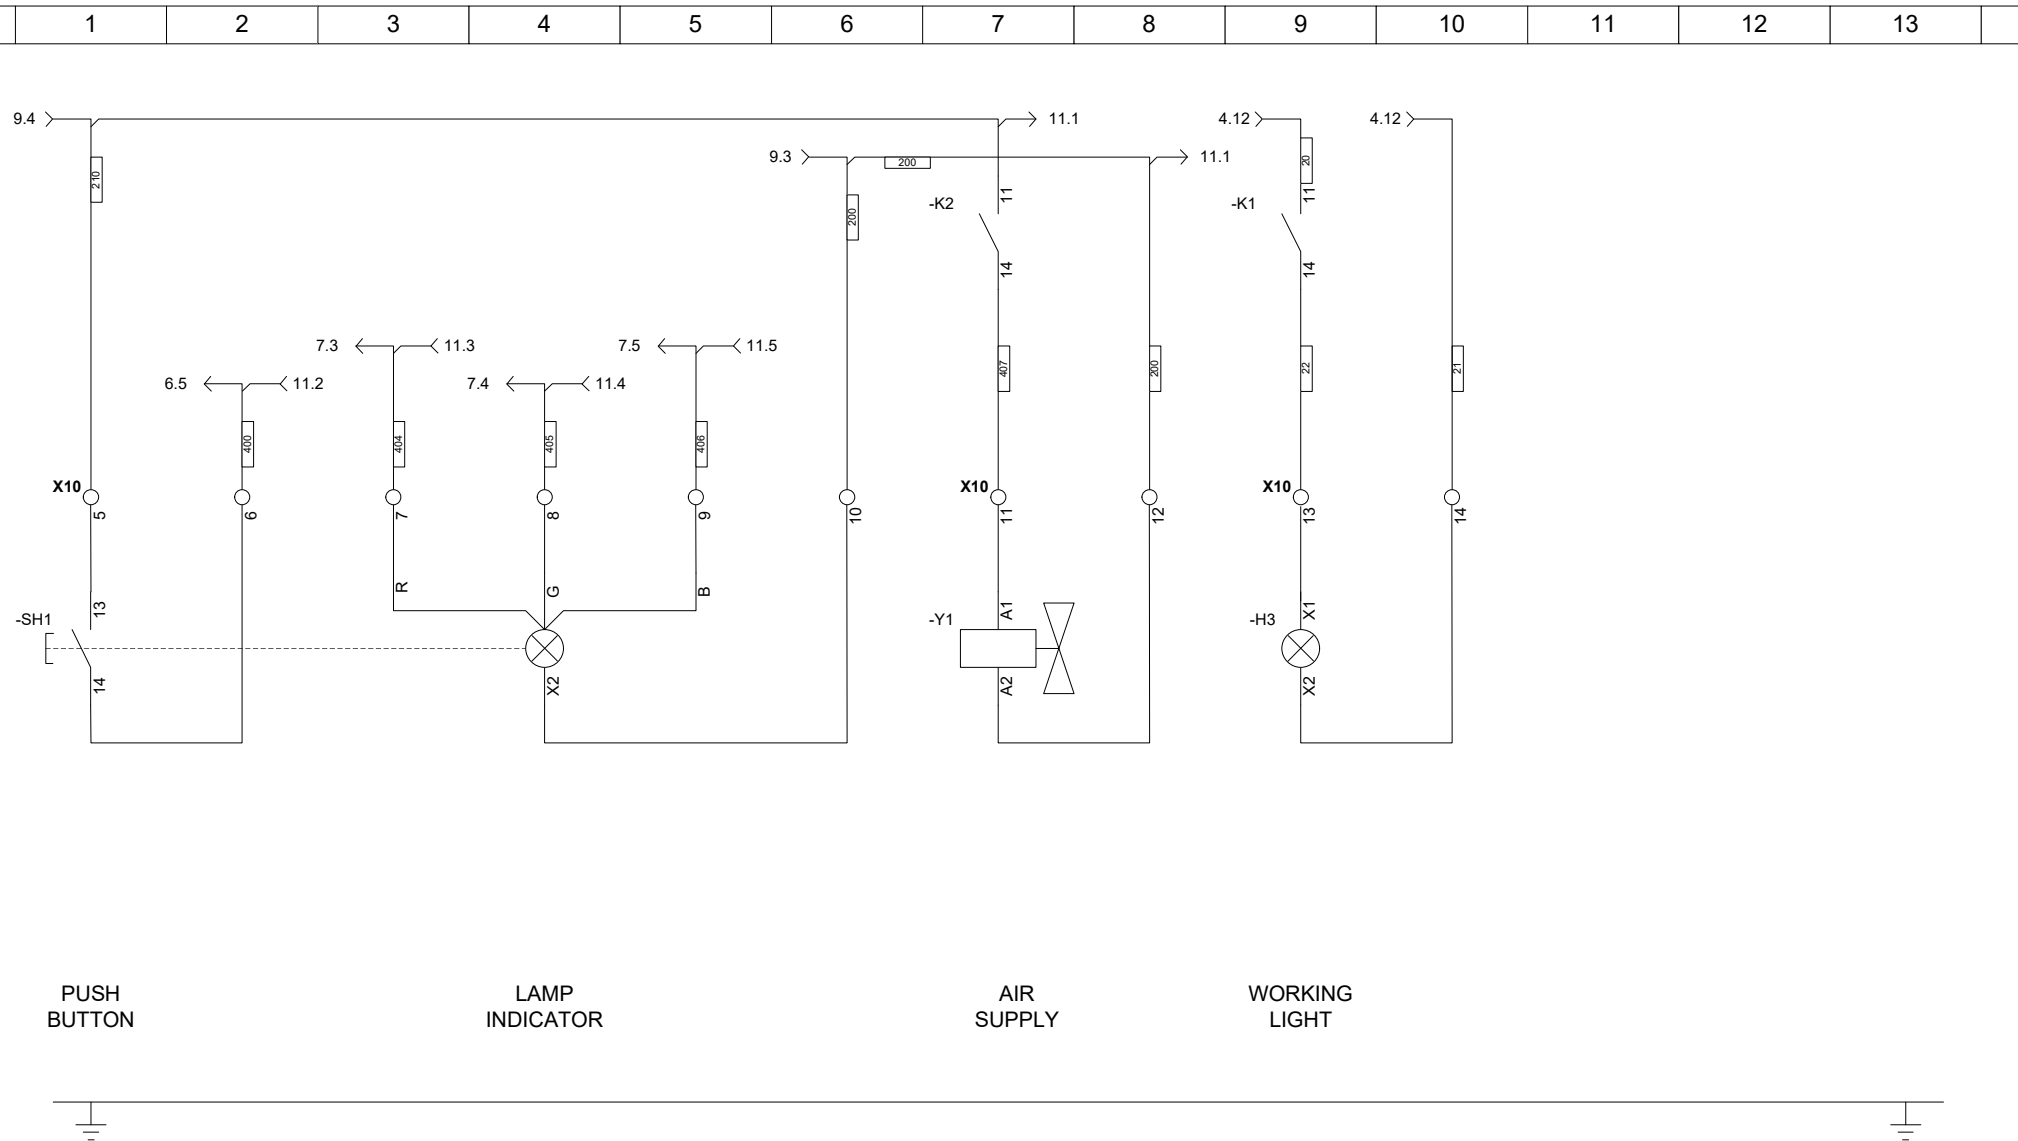

+A(x)	Location :		Function :		ELECTRICAL DEPARTMENT		
	Control SMARTWALL		EXTERNAL ELEMENTS		Rev. date	28-07-2022	
CONTROL PANEL	Document : HBC-FILTERBANK-UK-230V-Rev1.vsd		Order no:		REV	1	
	Date : 19-08-2022		Reference :		Page :	10	Of : 11

SMARTWALL

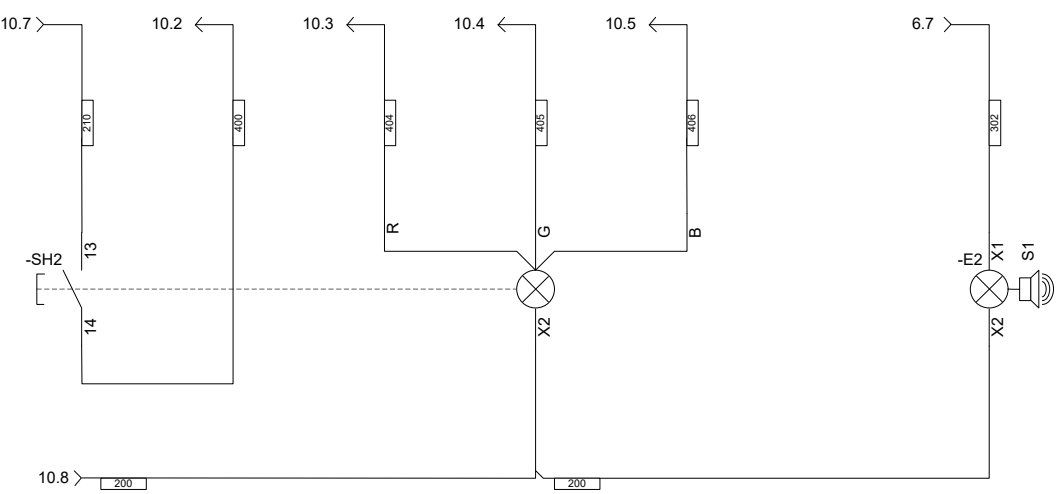

PUSH
BUTTON

LAMP
INDICATOR

LAMP/SOUND
INDICATOR

+A(x)	Location :		Control SMARTWALL		Function :				ELECTRICAL DEPARTMENT								
					FRONT LID				Rev. date	28-07-2022							
CONTROL PANEL									REV	1							
		Document :	HBC-FILTERBANK-UK-230V-Rev1.vsd		Order no:			Reference :			Date :	19-08-2022		Page :	11	Of :	11